



PIEDMONT
ENVIRONMENTAL
ASSOCIATES, P.A.

September 10, 2022

Project # 3040

KC2 Enterprises
c/o: Kyler Zadell
910 Windy Rd.
Apex, NC 27502

RE: Preliminary Soil Investigation on Property Located North Pea Ridge Road, Chatham County, Parcel Numbers 17531 & 17473

Mr. Zadell,

This report details the findings of a preliminary site and soil evaluation performed on the tract(s) referenced above. The evaluation was conducted at the clients written request to determine the site's suitability for the installation of sub-surface wastewater disposal systems to serve domestic strength wastewater. This evaluation was for residential wastewater applications. Any other type of use may require additional testing and/or stricter setbacks. This report does not address systems receiving more than 3,000 gallons per day of flow.

The evaluation was conducted by Chris Murray, North Carolina Licensed Soil Scientist in August, 2022. The evaluation was conducted during moist soil conditions with the use of a hand-auger to determine soil suitability for on-site sewage disposal systems in accordance with 15A NCAC 18A .1900 "Laws and Rules for Sewage Treatment and Disposal Systems". Characteristics that affect the suitability of sub-surface systems include soil depth to expansive clay, seasonal high-water table, rock, and unusable saprolite. Topography and slope also affect the suitability of an area for septic systems. The evaluation of these components was conducted on the site. The level of the evaluation was detailed for this tract.

Findings are conveyed by showing areas on the enclosed map that are usable for different system types. Areas suitable for low profile chamber wastewater systems are hatched in orange. These areas have usable topography and a minimum slope-corrected soil depth of 20 inches. Areas suitable for sub-surface drip wastewater systems are hatched in pink. These areas have usable topography and a minimum slope-corrected soil depth of 13 inches. Areas suitable for surface drip wastewater systems are hatched in blue. These areas have usable topography and may need amendment to meet standards set forth by NCDEQ, the agency responsible for the regulation of these systems. All hatched areas are generated using gps technology in the field and are not survey located. The areas are labeled with approximate square footages.

Once the soils map is complete the size of area required for a septic system can be estimated. Residential systems are sized according to the number of bedrooms in the proposed dwelling. Systems are not sized based on the number of bathrooms in the dwelling. Each bedroom in the proposed dwelling is calculated to generate a daily flow of 120 gallons. A four-bedroom dwelling would have a daily calculated flow of 480 gallons. The daily flow is divided by the loading rate based on the soil texture. This site has a clay texture so would have an estimated long-term acceptance rate (LTAR) of 0.25 gallons per square foot of trench bottom per day. The minimum required area or square footage on the ground for the primary septic system and the repair area with this LTAR for the conventional hatched areas would be approximately 12,000 – 15,000 square feet. These areas must meet all setbacks from property lines, wells, water lines and structures as well as any other easement imposed by other entity. All lots will require an application and evaluation by the county health department on an individual basis.

We have reviewed the proposed subdivision plan for this project and have found it to be sufficient from an on-site wastewater perspective. Each lot is shown on the attached soil map with one of the three system types outlined above. Table 1 lists the proposed septic system types for each of the proposed lots:

Table 1 - N. Pea Ridge Rd. Project - Preliminary Septic Information, September, 2022

Lot	System Type*	Available Sq Footage
1	Surface Drip	22483
2	Sub-surface Drip	29902
3	Sub-surface Drip	18817
4	Sub-surface Drip	18976
5	Sub-surface Drip	11398
6	Surface Drip	22041
7	Surface Drip	16249
8	Sub-surface Drip	18462
9	Surface Drip	25204
10	Surface Drip	18498
11	Sub-surface Drip	34632
12	Sub-surface Drip	34117
13	Sub-surface Drip	29055
14	Sub-surface Drip	30401
15	Sub-surface Drip	21790
16	Low Profile Chamber	19859
17	Low Profile Chamber	30896
18	Low Profile Chamber	33221
19	Sub-surface Drip	12000
20	Sub-surface Drip	12563
21	Sub-surface Drip	11033

22	Low Profile Chamber	17649
23	Sub-surface Drip	15363
24	Sub-surface Drip	10754
25	Surface Drip	14819
26	Surface Drip	14593
27	Surface Drip	14532
28	Surface Drip	18749
29	Surface Drip	26298

*Surface and sub-surface drip systems will require additional testing per NCDEH and NCDEQ regulations

This report discusses the general location of potentially usable soils for on-site wastewater disposal and the soil and site limitations on the property that exists at the time of the evaluation. Piedmont Environmental Associates, PA (“Piedmont”) provides professional consulting specializing in the practice of soil science and wastewater management. Piedmont is therefore hired for its professional opinion regarding these matters. Laws and rules governing wastewater treatment and disposal are forever evolving and subject to the interpretation and opinion of individuals which are employed by local and state agencies that govern these laws and rules. Due to this fact, Piedmont cannot guarantee in any way that any area located in the field, shown on a sketch, or discussed with the client will be permitted by any of these agencies. It is for this reason that **Piedmont strongly recommends to anyone considering a financial commitment on any piece of property be completely aware of all permit requirements on that property before purchase and obtain those permits prior to a final financial commitment.** We are pleased to be of service in this matter. If you have any further questions, please feel free to call (336)662-5487

Sincerely,



Chris Murray
 NC Licensed Soil Scientist # Chris Murray
 Piedmont Environmental Associates, P.A.

Attachment I


.1950 Location of Sanitary Sewage Systems

- (c) Every sanitary sewage treatment and disposal system shall be located at least the minimum horizontal distance from the following:
- | | |
|---|----------|
| (1) Any private water supply source including a well or spring | 100 feet |
| (2) Any public water supply source | 100 feet |
| (3) Streams classified as WS-I | 100 feet |
| (4) Water classified as S.A.
from mean high water mark | 100 feet |
| (5) Other coastal waters
from mean high water mark | 50 feet |
| (6) Any other stream, canal, marsh, or other surface waters | 50 feet |
| (7) Any Class I or Class II reservoir
from normal pool elevation | 100 feet |
| (8) Any permanent storm water retention pond
from flood pool elevation | 50 feet |
| (9) Any other lake or pond
from normal pool elevation | 50 feet |
| (10) Any building foundation | 5 feet |
| (11) Any basement | 15 feet |
| (12) Any property line | 10 feet |
| (13) Top of slope of embankments or cuts of 2 feet or more
vertical height | 15 feet |
| (14) Any water line | 10 feet |
| (15) Drainage systems: | |
| (A) Interceptor drains, foundation drains and storm water diversions | |
| (i) upslope | 10 feet |
| (ii) sideslope | 15 feet |
| (iii) downslope | 25 feet |
| (B) Groundwater lowering ditched and devices | 25 feet |
| (16) any swimming pool | 15 feet |
| (17) any other nitrification field (except repair area) | 20 feet |
- (b) Ground absorption, sewage treatment and disposal systems may be located closer than 100 feet from a private well supply, except springs and uncased wells located downslope and used as a source of drinking water, repairs, space limitations and other site-planning considerations but shall be located the maximum feasible distance and, in no case, less than 50 feet.
- (c) Nitrification fields and repair areas shall not be located under paved areas or areas subject to vehicular traffic. If effluent is to be conveyed under areas subject to vehicular traffic, ductile iron or its equivalent pipe shall be used. However, pipe specified in Rule .1955 (e) may be used if a minimum of 30 inches of compacted cover is provided over the pipe.

Note: Systems over 3000 GPD or an individual nitrification fields with a capacity of 1500 GPD or more have more restrictive setback requirements, see .1950 (a) (17) (d) for specifics.



1 inch = 400 feet

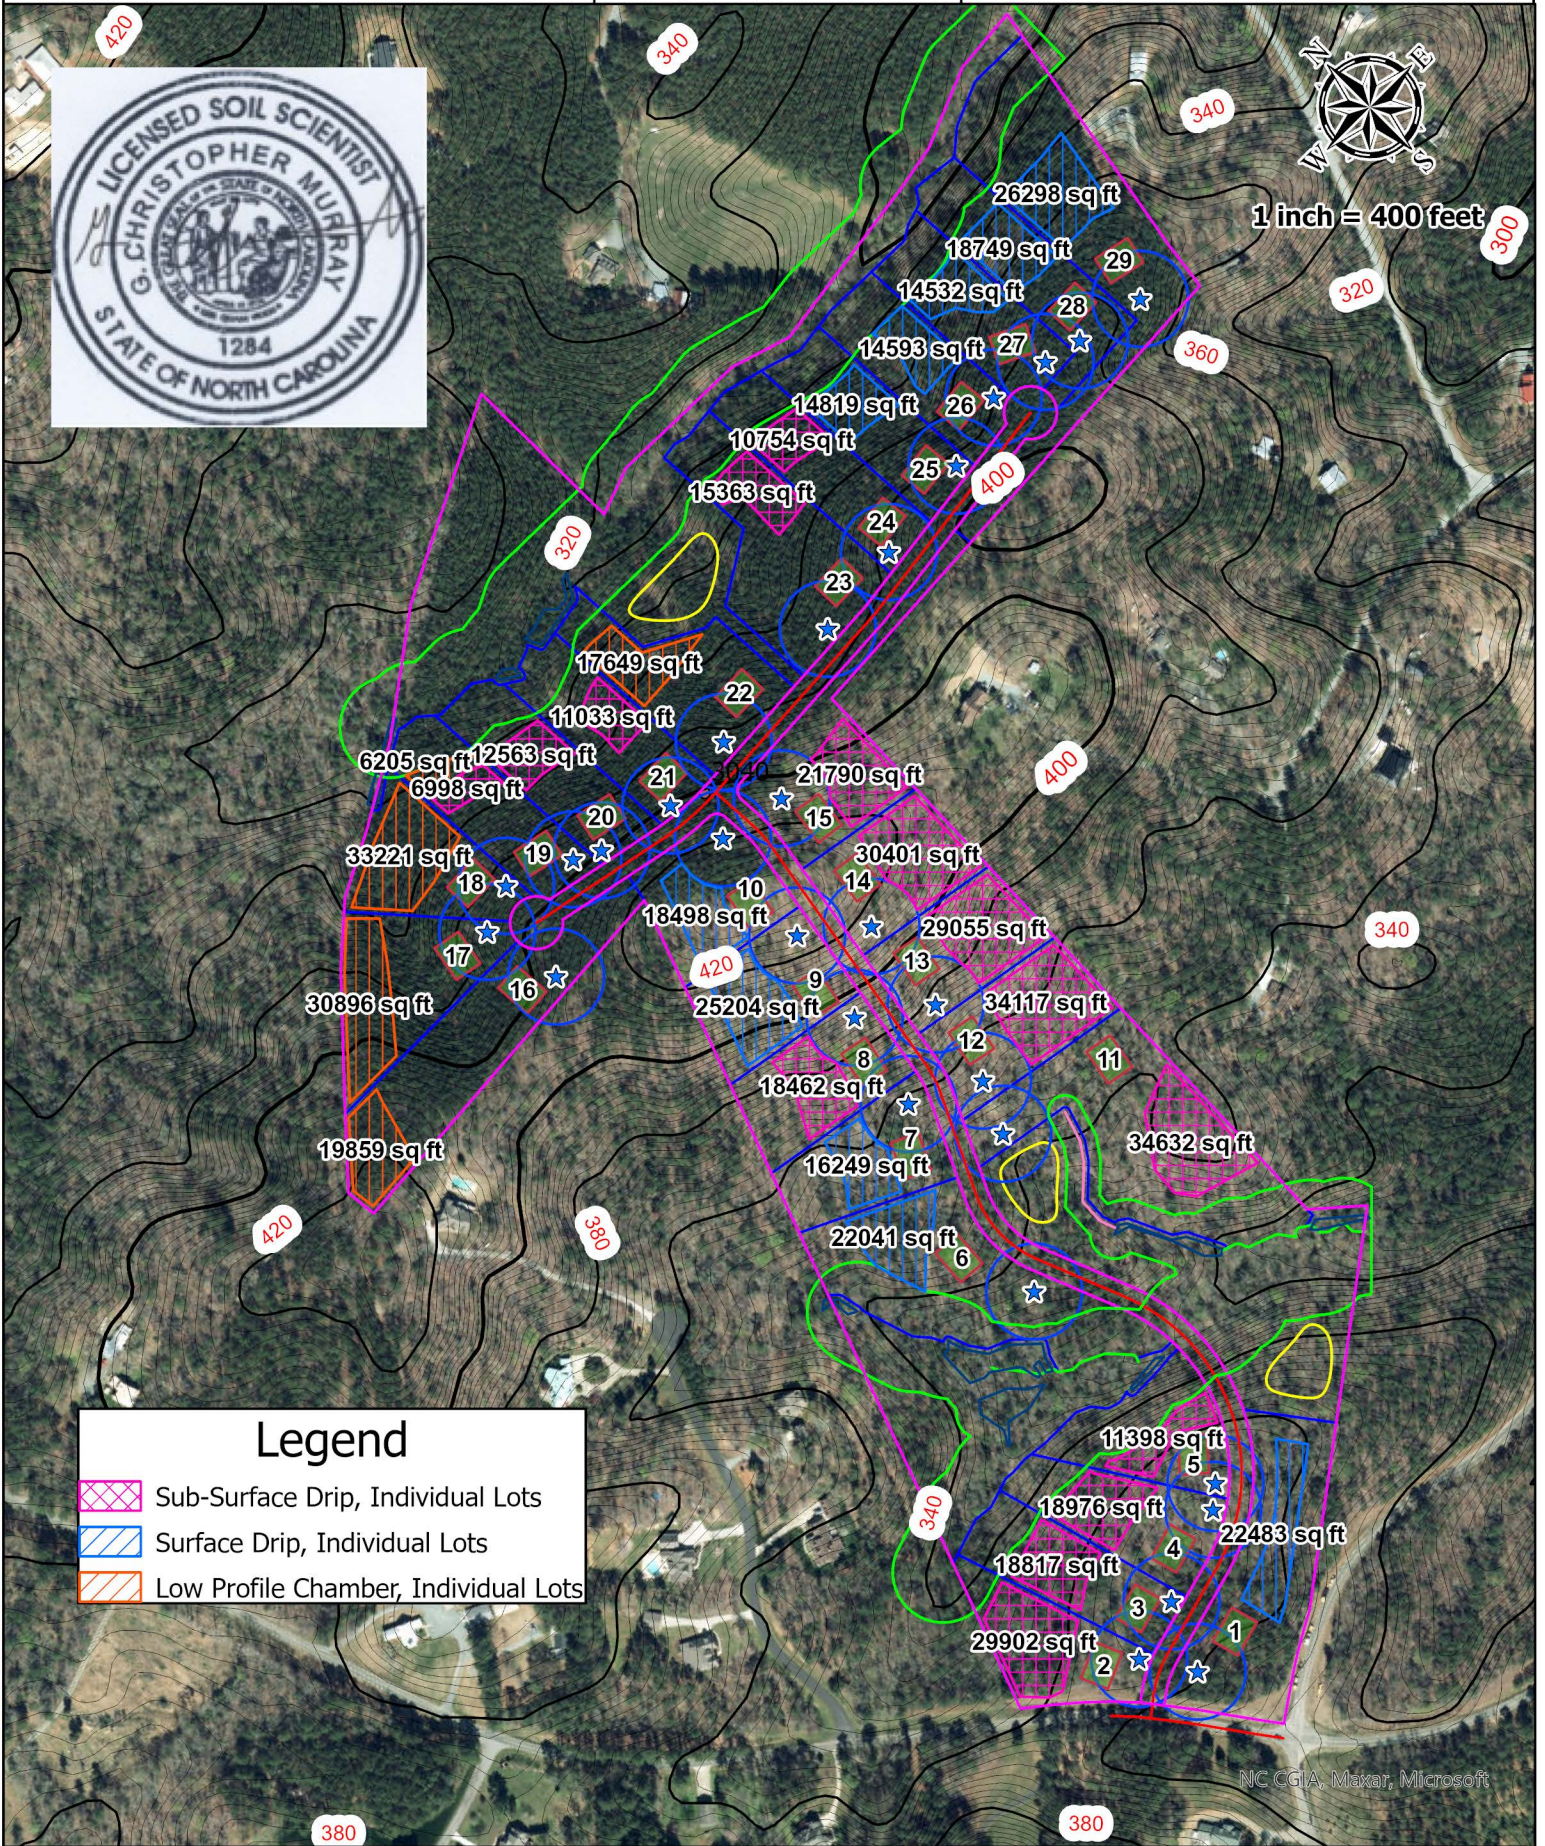

Legend

- Sub-Surface Drip, Individual Lots
- Surface Drip, Individual Lots
- Low Profile Chamber, Individual Lots